


Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400 Fax (03) 9371 2499

TEST REPORT

Client :	19-21 Lanyo	Preference Floors 9-21 Lanyon Street Dandenong VIC 3175			Test I Issue Print		17-00464 4/09/2017 5/09/2017	7
Sample Description		Clients Ref : "Aspire RCB Hybrid" Tongue & Groove Flooring End Use : Floating Floors Nominal Composition : PVC/Calcium Carbonate/Foam Nominal Thickness : 5.5mm						
S/ISO 9239.1-2003		Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a Radiant Heat Source						
		Date of Sample Arrival			25/08/2	2017		
		Date Tested 01/09/2017						
		CHF Value		1	2	3	Mean	
		Length		7.0	7.6	7.8	7.5	kW/m²
		Width		8.3	-	-	-	kW/m²
		Smoke Value		1	2	3	Mean	
		Length		154	158	158	157	%.min
		Width		158	-	-	-	%.min
		Melting					Yes	
		Blistering					Yes	
		The test results relate to conditions of the test, the hazard of the product in Sample was conditioned relative humidity of 50±5	ey are not inte use. I in accordanc	nded to be s e with BSEN	ole criterion fo 13238:2001 a	r assessing t it a temperat	the potential	fire

Each specimen was clamped to a substrate of 6mm thick fibre reinforced cement board prior to testing.

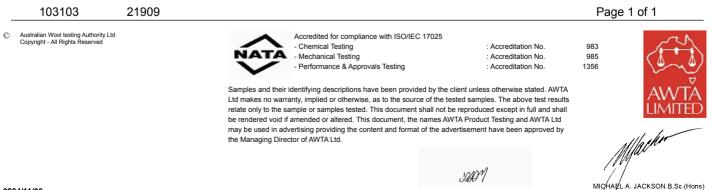

APPROVED SIGNATORY

MANAGING DIRECTOR