



Accredited for compliance with ISO/IEC 17025 – Testing  
NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration and inspection reports

## OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

### Easi-Plank SPC Hybrid Matte

**Prepared for:** Preference Floors  
Steven Keats  
19 - 21 Lanyon Street  
DANDENONG SOUTH VIC 3175

**Specimen Description:** Easi-Plank SPC Hybrid Matte, 230x900 mm.

**No. of Specimens:** 2 off

**Surface Structure:** Smooth

**Specimen Preparation:** Washed with water and pH neutral detergent, rinsed then dried.

**Specimen Configuration:** Unfixed

**Test Direction:** Test conducted parallel with surface profile.

**Joint Type & Width:** N/A

**Air Temperature:** 21°C

**Test Standard:** AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

**Test Shoe:** Leipzig V73-SP

**Test Location:** ATTAR, Unit 1, 64 Bridge Road, Keysborough.

**Test Date:** 20 January 2020

**Test Personnel:** Awel Guled and Dale Siegle

<b>Displacement Space</b> (rounded to the nearest 0.5cm <sup>3</sup> /dm <sup>2</sup> ):	Not tested
<b>Displacement Space Assessment Group</b> (Appendix E, AS 4586 - 2013):	Not tested
<b>Corrected mean overall acceptance angle (<math>\alpha_{ave}</math>)</b> (rounded down to the nearest degree):	13°
<b>Classification:</b>	R10

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.


Reviewed By:



Dale Siegle  
Compliance and Test Technician  
Approved Signatory



Awel Guled  
Compliance and Test Technician  
Approved Signatory

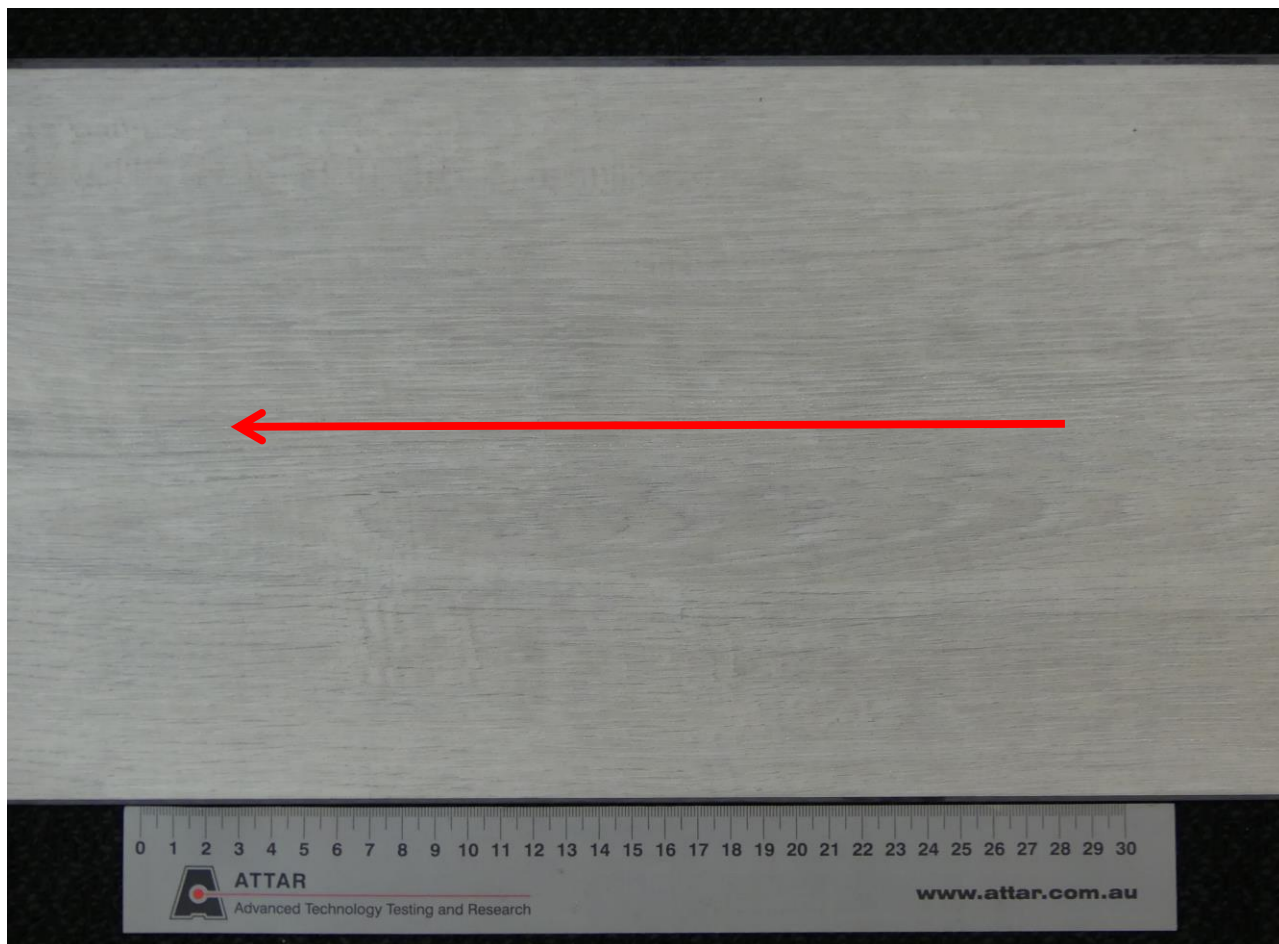

**Figure 1:** Easi-Plank SPC Hybrid Matte  
Arrow indicates direction of testing

**CLASSIFICATION CRITERIA – AS 4586 - 2013**  
**Oil Wet Inclining Platform Test – Appendix D**

**Compliance**

**TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST**

<b>Classification</b>	<b>Angle, degrees</b>
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35